
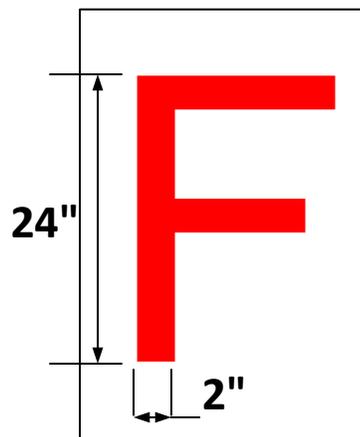
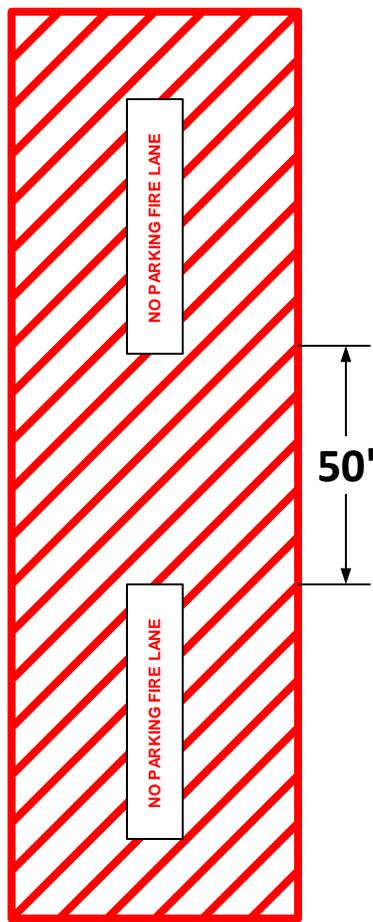



# Fire Lane Marking Specifications

- All approved fire apparatus access lanes shall be marked with appropriate signs and designed according to the prescribed specifications.
- Fire apparatus access lane shall have an unobstructed width of not less than 20' and an unobstructed vertical clearance of not less than 15'.
- Where a fire hydrant is located on a fire apparatus access lane or the building exceeds 30' in height AFG, the fire apparatus access lane width shall be not less than 26'.
- The Fire Official shall have the authority to require an increase in the minimum access widths where they are inadequate for fire or rescue operations.
- Fire apparatus access lane shall be designed and maintained to support a minimum of 75,000 lbs. and shall be surfaced so as to provide all weather driving capabilities.
- **All designated fire lanes shall be marked accordingly:**
  - The perimeter of the fire lanes shall be designated by the Fire Official.
  - All Stripes shall be 5" in width and red in color.
  - The interior area shall be marked with 5" red stripes at 45 degree angles to the perimeter strip and be 4' on center.
  - All letters shall be 24" tall and have a 2" stroke.
- The top and side of curbing shall be painted red along with a solid red line 20' from the curbing to delineate the perimeter of the fire apparatus access lane.
- Permanent wording "NO PARKING FIRE LANE" shall be painted in red on the surface of the fire apparatus access lane at intervals of 50' with letters measuring not less than 24" in height.

←A minimum 20'→

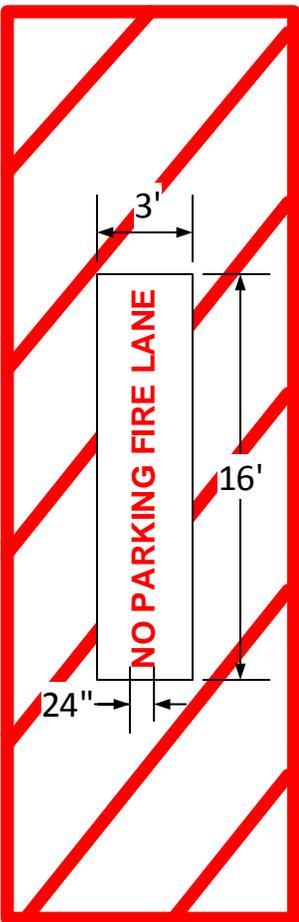

## Curb Styles

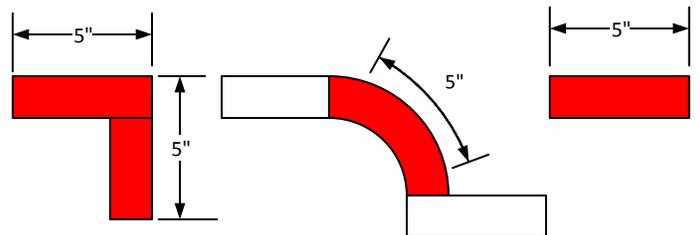

<b>Fire Lane Marking</b>							
<b>City of Waynesboro, VA</b>		SIZE	FSCM NO	DWG NO		REV	
DRAWN	Fitzgerald, GG			FLM-1			
ISSUED	January 20, 2017	SCALE	1 : 1	SHEET		1 OF 1	