


Fire Apparatus Access Lane Specifications

- All approved fire apparatus access lanes shall be marked with appropriate signs and designed according to the prescribed specifications.

Fire Apparatus Access Lane Sign Specifications:

- Fire apparatus access lane signs and markings shall be maintained in a clean and legible condition at all times and replaced when necessary to ensure adequate visibility.
- Fire apparatus access lane signs are to be made of a heavy-gauge, sign-grade aluminum and permanently installed using rust resistant fasteners.
- Fire apparatus access lane signs are to read "NO PARKING OR STANDING FIRE LANE."
- Fire lane signs shall have a minimum dimension of 12" in width and 18" in height and have red letters on a white reflective background.
- Fire lane signs shall be installed every 75' with the bottom of the sign not less than 7' AFG and the top of the sign not more than 9' AFG.

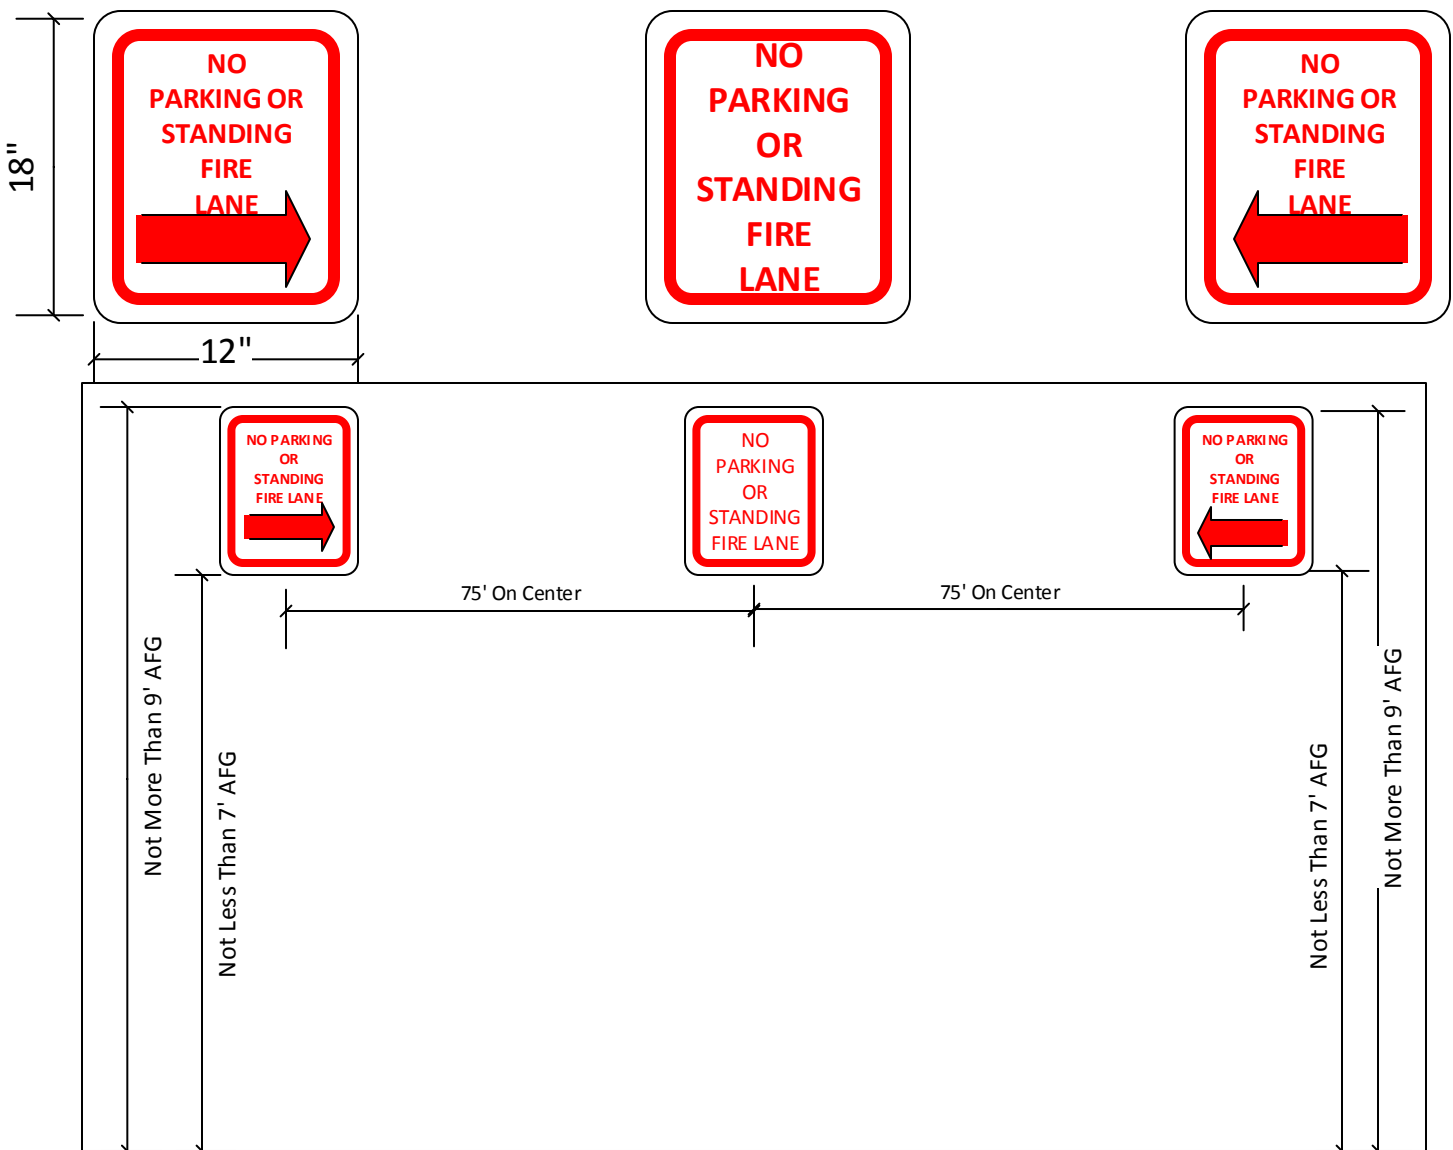

City of Waynesboro Fire Department		SIZE	FSCM NO	DWG NO	REV
		8.5 x 11		FAL-FS.1	
DRAWN	Fitzgerald, GG	ISSUED	January 19, 2017	SCALE	1 : 1
			Fire Apparatus Lane Access Sign	SHEET	1 OF 1